We touch your electricity everyday!



Cast Resin Insulated Busway System





Manufacturing Facilities





•

The Eta-com group was founded in 1979 and ever since markets a full range of cast resin insulated busway systems. The concept which was already in use in the sixties in industrial installations is now in the third generation form. Due to the typical characteristics, the system guarantees the integrity of many projects world-wide, providing safe and maintenance free electrical power supplies in both Low Voltage and Medium Voltage installations.

C&S Electric Ltd. was founded in 1966 and is amongst the leading suppliers of electrical equipment in India. It's wide range of electrical and electronic products find application in power generation, distribution, control, protection and final consumption.

C&S employs over 4000 people including 400 engineers, and has 17 state-of-the-art manufacturing plants. It has 22 sales/marketing offices across India and its products are exported to more than 80 countries. C&S Electric also has joint venture companies with global leaders.

The Power Busbar Division of C&S founded in 1982 has been meeting the evolving needs of power generating stations, process and manufacturing industries, infrastructure establishments, technology and technological centers and real estate developments with its complete and fully tested product line of Busduct, Bustrunking and associated equipment.

With the acquisition of Eta-com in December 2011, the co-operation between the two companies give birth to a Global Power Busbars Specialist.









betobars in low & medium voltage installations.

This concept is unique as it is based on the direct encapsulation of copper or aluminium conductors with an insulation compound, B.I.M. casting mix, consisting of epoxy-resin mixed under vacuum. This B.I.M. casting mix has excellent electrical characteristics and high mechanical withstand with specific physical properties. It is moisture-resistant, fire-resistant and self extinguishing. A flexible fabrication method, universal moulds and an integrated process controlled mixing technique allow the production of an almost unlimited number of element forms for L.V as for M.V applications. The prefabricated elements are self-supporting and are interconnected electrically by joining the conductors with 2-sided compression contacts, ensuring an excess of contact surfaces and a maximum of adjustment. Junctions and element extremities are overcast with a B.I.M. casting mix resulting in a homogeneous insulation over the full length of the connection.

busbars can be supplied in the following standard types:

For Low Voltage

LA-LB series Up to 1000 VAC / 1500 VDC Three phase conductors and/or Protective earth / 50,100,150 % neutral

Al-conductors range up to 5040 A Cu-conductors range up to 6300 A

DC application on request Other frequencies on request



degree of protection



For Medium Voltage

Voltage Rating **Current Rating** Type SH - Series Al upto 1645A 3.6 KV to 12 KV

Cu upto 2030A

PH - Series 3.6 KV to 17.5 KV Al upto 4967A

Cu upto 6140A

Other current and voltage ratings on request.

IP67 degree of protection





on request





ISOUCH range covers Isolated Phase Busduct, Segregated Phase Busducts and Non-Segregated Phase Busducts.

C&S is a market leader in India and amongst the major global companies for design, manufacture, erection and commissioning of Isolated Phase Bus Ducts up to 1000MW power plants.

Today, we have an enviable track record of having associated with 14 Units of 660 MW, 25 Units of 500 MW, 35 Units of 250 MW, 30 Units of 150 MW Thermal Power Stations, Hydro Power Plants and Nuclear Power Plants, besides many Captive/Private Power Projects of capacity less than 100 MW. The largest proportion of power generated in India flows through C&S **150** DOC busducts.

ISOUCH Busduct have been successfully type tested for highest peak current during short circuit test and also for temperature rise test at world famous laboratories like KEMA-Holland and EDF-France, CPRI-Bhopal & Bangalore and at IIT-Roorkee (For Seismic tests)

Isolated Phase Busduct

C&S offers a wide range of natural air cooled Isolated Phase Busducts from 11 kV to 36 kV upto 30000A with a maximum Short Circuit Current withstand capability of 300 kA rms for 1sec. and 840 kA peak. These IPB's have applications in all generating station from 60 MW and above.



Segregated Phase Busducts

C&S offer a wide range of Segregated Phase Busducts for Medium Voltage applications from 3.3 kV to 33 kV upto 5000A. Segregated Phase Busducts find applications in Power Generating Stations and Industrial or Distribution Plants for lower capacity generator connections, interconnections between switchgear and transformers.



Other Products

- Non-Segregated Phase Busducts (415 to 1100V upto 6500A)
- DC Busbar Systems
- PTSP Cubicles
- Generator Auxiliary Compartments (GAC)
- Neutral Grounding Cubicles
- Line & Neutral Side Terminal Boxes
- Pressurization System for IPB's
- Hot Air Blowing Equipment





 $\textbf{metabar} \ \text{range cover Sandwich Bustrunking, Air Insulated Bustrunking \& Lighting Trunking.}$

Energy Saver: Bustrunking has lower impedance in comparison to cable and conventional busducts for the same application. Lower impedance means less energy lost during distribution and this translates into cost savings.

Flexible Distribution: Plug-in type arrangement at regular intervals or as per customer design provides efficient power distribution.

Less Space: Bustrunking system require less space for Installation in a building / industry as compared to conventional busduct and cable system, so optimum utilization of space.

Conserves Raw-materials & Produces less waste: Material and manpower used in busway is lower than cable & conventional busduct. It saves money on raw materials and create less waste by buying pre-engineered lengths of busway.

Reusable: Bustrunking system comes with provision of expansions, changes, replacement and reusing.

SB - Sandwich Type	
Compliance of Standard	IEC 61439 (1&6) & IS 8623 (1&2)
Independent Certificate Authority	ASTA - UK, CPRI-India
Conductor Material & Ratings	Copper 630A ~ 6600A, Aluminium 400A ~ 5000A
Rate Operational Voltage (Ue)	1000 Volt, AC
Rated Impulse Withstand Voltate (Uimp)	12 KV (1.2/50 s)
Enclosure Material	G.I/AL
Busbar Insulation	Multi layer Class - 'F' Insulation
Degree of Protection	IP 54/ IP55 /IP65 /IP67
Fire Rating	240Min. (ISO 834) 55
Seismic Compliance	Zone -5 (IS: 1893/IEEE 693)
Section Jointing	Uniblock Joint
Plug - in Box	32~800A




Compliance of Standard IEC 61439 (1&6) & IS 8623 (1&2) Independent Certification Authority ASTA-UK, CPRI-India Conductor Material & Ratings Copper 125~2000A, Aluminium 200~1250A Rated Operational Voltage (Ue) 1000 Volt, AC	
Conductor Material & Ratings Copper 125~2000A, Aluminium 200~1250A	
Rated Operational Voltage (Ue) 1000 Volt, AC	
Rated Impulse Withstand Voltage (Uimp) 12 KV (1.2/50 s)	
Enclosure Material G.I	
Busbar Insulator Class-F	
Degree of Protection IP 54/55	
Fire Rating 120Min. (ISO 834) 55	
Seismic Compliance Zone-5 (IS:1893/IEEE 693)	
Section Jointing Uniblock Joint	
Plug in Box 32 ~ 800 A	



LB-Lighting Trunking	
Compliance of Standard	IEC 61439 (1&6) & IS 8623 (1&2)
Independent Certificate Authority	CPRI - India
Conductor Material & Ratings	Copper - 25A, 32A, 40A, 63A
Rated Operational Voltage (Ue)	500 Volt, AC
Enclosure Material	Aluminium
Busbar Insulation	Flame Retardant PVC (Class 'A'-105 Deg C)
Section Jointing	Inbuilt push fit joint
Plug in Box rating	Upto 16 A (with/without fuse)
Degree of Protection	IP55/IP54





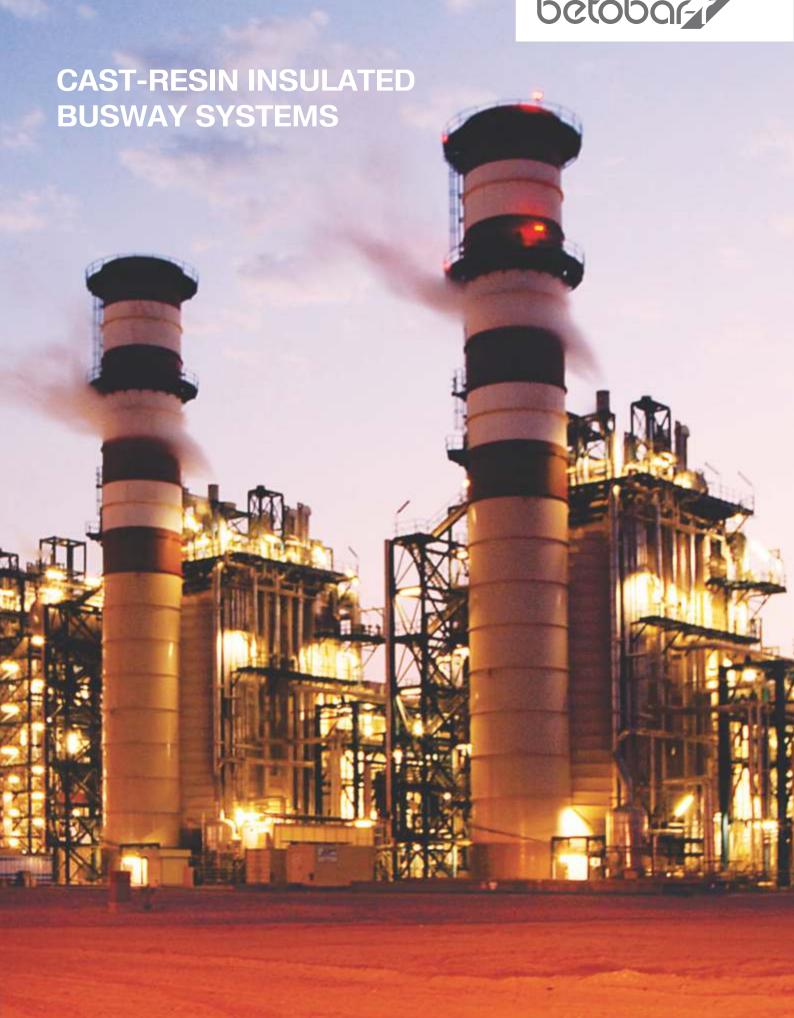

Extensive application and Element Range

botoboa busbars are suitable for application in large buildings, industrial plants, power stations, sub-stations and large switchrooms, such as:

- Factory distribution of low and medium voltage power.
- Rising mains with tap-offs to sub-distribution boards in high rise buildings.
- Transformer switchboard connections.
- Main switchboard feeders to distribution panels.
- Generator and large motor feeders.
- 400 Hz distribution systems.
- Refineries, offshore and onshore platforms.
- Zone 2 & Zone 3 Explosive areas.

For special Application, contact our betobard agent.

botobora busway system is available in a wide range of standard element shapes, forms, and lengths which are fabricated to suit the typical project requirements. Our element range consists of:

- · Straight elements.
- Flat and edge elbows.
- Z (double elbow) and T elements.
- Flanged terminal elements.
- Tap-off facilities and phase-transfer elements.
- Thermal expansion compensation elements.
- Tailor-made terminal elements for transformer or generator and switchboard connection.









High-Quality Production

betobar busbars have been developed as a modern, all-purpose means of efficient and safe transmission of electrical energy. They have been in manufacture for more than thirty-five years.

betobar system complies with all the requirements for current distribution at low and medium voltage.


The busbar consists of copper or aluminium conductors, embedded in an enclosure of a fire retardant, self extinguishing and homogeneous insulation mix based on epoxy cast-resin with mineral fillers, ensuring high mechanical strength and chemical withstand.

Standard types are available for current ratings up to 5000 A and voltage ratings up to 17.5kV. Systems for higher current ratings or DC applications are possible on request.

The busbar line consists of a number of prefabricated elements. The electrical joining of the conductors is achieved by means of double fish plates and high tensile steel bolts.

The junctions and the element ends are overcast with the same insulation mix as used for the elements. In this way an integral insulating enclosure to IP68.IK10 is guaranteed over the full length of the busbar run. Straight junctions and also elbow junctions are available, each facilitating installation adjustments of 0-20 mm per standard junction.



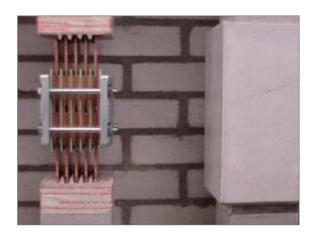




Major Advantages

- Compact Dimensions.
- Simple Installation.
- Low Voltage Drop and High Short-Circuit withstand Capacity.
- Overload Capacity of +20% for 2 Hours.
- Degree of Protection of IP68 for L.V bus ways and IP67 for M.V bus ways as per IEC 60529.
- High Mechanical Impact strength of IK.10 as per DIN 52453 & IEC 62262.
- Fire proof property: Tested for 750°C for 3 Hours in accordance with IEC 60331-21.

 Tested for 850°C for 2 Hours in accordance with pre-BS 7346.
- Fire Wall Bushings of S90 & S120 in accordance with EN1366-3 and NBN 713.020.
- Fire Retardant Bushings A90 for Normal fire and H60 for Hydrocarbon Fire In Offshore Applications.
- Self-extingusihing insulation as per IEC 60332.
- Electrical Continuity E30-E120 finishing available under fire conditions as per DIN 4102-12.
- EMC Compatible. (For sensitive environment)
- Insulation level of CLASS 'B', 130°C.
- Explosion Proof ATEX, & IEC Ex Certified on request.
- Excellent Resistance to atmospheric pollution & wide range of chemicals.






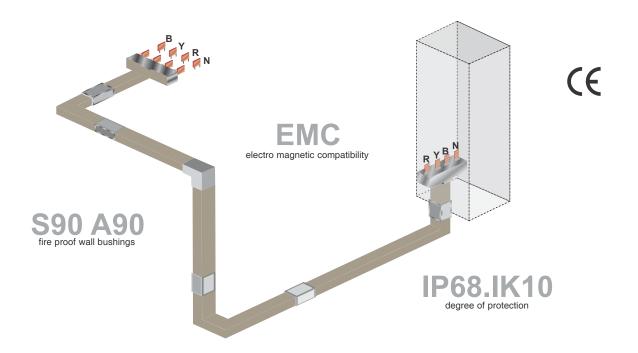




Product Certifications

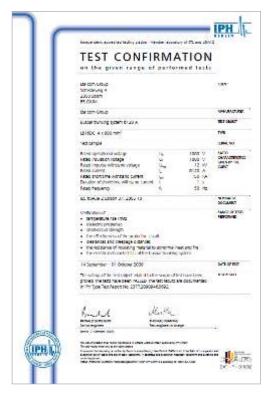


IPH Type Test Certificate for L. V. Betobar

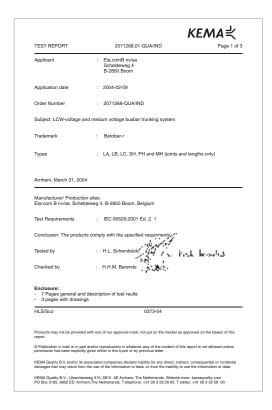

KEMA Type Test Certificate for Degree of Protection



KEMA Type Test Certificate for L. V. Betobar

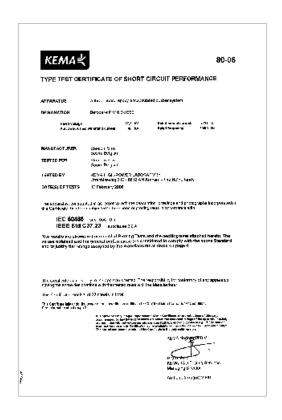

KEMA Type Test Certificate for M. V. Betobar



Product Certifications



ASTA Type Test Report



Flame Spread Test as per IEC 60332



Ageing Test Report



IEC Certification for Explosive Atmospheres



Product Certifications



ATEX Certification for Explosive Areas





ISO 9001:2008 Certificate


Electromagnetic Compatibility



Product Certification




GOST Certificate

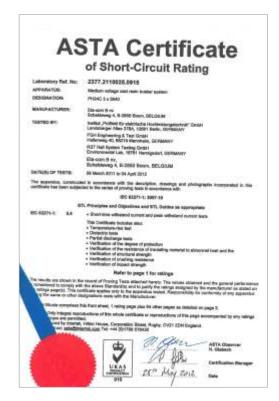

Type Test Report for M. V. Betobar



Type Test Report for L. V. Betobar

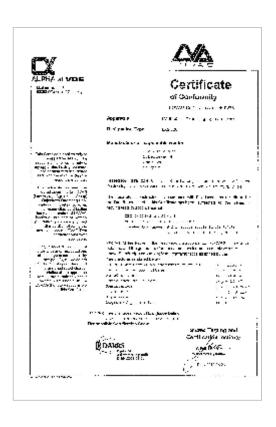

Type Test Report for L. V. Betobar




Low Voltage



Applications



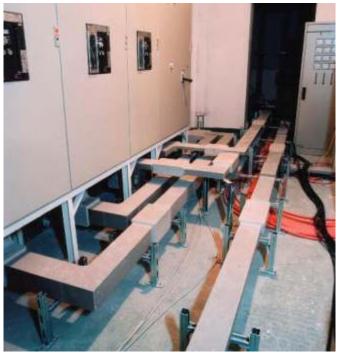







Technical Specifications for Low Voltage

Compliance Standard	IEC 61439 (1 & 6)
Independent Certification	KEMA, MPA (Germany), ISSeP, LCE, ASTA, IPH
Type of Series	LA - Single Duct & Double Duct - 3, 4 & 5 Pole LB - Single Duct - 6, 7, 8 & 9 Pole
Busbar Configuration	3 Phase 3 Phase + 100% Neutral 3 Phase + 100% Neutral + 100% Isolated Earth
Ratings	LA Copper Series 735A to 3375A (Single Duct) 3955A to 6300A (Double Duct) LB Copper Series 1795A to 3420A (Single Duct) LA Aluminium Series 513A to 2700A (Single Duct) 3159A to 5040A (Double Duct) LB Aluminium Series 1572A to 2736A (Single Duct)
Rated Operating Voltage	1000V, AC
Rated Insulation Voltage	1000V, AC
Rated Impluse withstand Voltage (U _{imp})	12kV (1.2/50 μs)
Rated Frequency	50Hz
Busbar Material	Copper - 99.9% Pure ETP Grade Aluminium - 99.5% Pure Grade
Insulation	CLASS 'B' (130°C)
Degree of Protection	IP68 as per IEC 60529
Mechanical Impact Strength	IK.10 as per DIN 52453 & IEC 62262
Tap Off Box	Upto 400A - Pluggable From 400A to 630A - Fixed Type
Conditions of use	Altitude upto 5000m, indoor as well as outdoor Ambient temperature ; -50°C/ +55°C Ambient Humidity : 0% - 100%


Aluminium betobar


Туре	3-4 cond	5 cond	In	Alum.	lcw	lpk	Rdc 20°C	Rac OT	X	Z	P Losses	Eler	nent Weig	ht *Kg/m
	BxH (mm)	BxH (mm)	Α	N,L1,L2,L3 mm²	1 sec kA	kA	μΩ/m	μΩ/m	μΩ/ m	μΩ/ m	@ In W/m	3 cond.	4 cond.	5 cond.
E single d	E single duct													
			513	160	15	30	181.3	235.7	53.2	241.6	190	20.4	20.6	20.7
LA 04EA	104 x 80	104 x 80	571	200	18	36	145.0	186.6	54.0	196.2	190	20.5	20.7	20.9
			635	240	22	46	120.8	157.2	54.7	166.4	190	20.7	20.9	21.1
		20 104 x 120	893	320	24	50	90.6	117.8	32.1	122.1	280	30.9	31.2	31.5
LA 08EA	104 x 120 1		995	400	31	65	72.5	94.9	32.8	100.4	280	31.1	31.5	31.9
			1163	480	32	67	60.4	79.7	23.0	83	322	41.3	41.8	42.2
LA 12EA	104 x 160	104 x 160	1295	600	40	84	48.3	64.3	23.6	68.5	322	41.7	42.2	42.8
			1413	720	48	101	40.3	54.0	24.2	59.2	322	42	42.7	43.4
			1624	800	46	97	36.3	49.1	18.5	52.5	387	52.2	53	53.8
LA 16EA	104 x 200	104 x 200	1760	960	55	121	30.2	41.8	19.0	45.9	387	52.7	53.6	54.5
			1932	1000	59	130	29.0	40.1	15.2	42.9	448	62.8	63.7	64.7
LA 20EA	104 x 240	104 x 240	2092	1200	71	156	24.2	34.2	15.7	37.6	448	63.4	64.5	65.7
		104 x 285	2430	1440	76	167	20.1	27.0	13.3	30.1	475	75.3	76.7	78
LA 24EA	104 x 285	114 x 285	2700	1920	88	194	15.1	20.9	14.1	25.2	475	76.7	78.5	87.2

Туре		8-10 cond	10 cond In A	Alum.	lcw	lpk	Rdc 20°C			Z	P Losses	Element Weight *Kg/m			
BXIT (IIIIII	BxH (mm)	BXH (mm)		N,L1,L2,L3 mm²	1 sec kA	kA	μΩ/m	μΩ/ m	μΩ/ m	μΩ/ m	@ In W/m	6/7 cond.	8 cond.	10 cond.	
D double	D double duct														
LA 16DA	344 x 200	200 344 x 200	3159	2 x 800	96	211	18.1	24.5	9.3	26.2	732	104.4	106	107.5	
LA TODA	044 X 200		3424	2 x 960	115	253	15.1	20.9	9.5	23.0	732	105.4	107.2	109.1	
LA 20DA	244 y 240	344 x 240	3492	2 x 1000	98	216	14.5	20.1	7.6	21.5	735	125.6	127.5	129.4	
LA ZUDA	A 20DA 344 x 240 344 :	344 X 240	3783	2 x 1200	117	257	12.1	17.1	7.8	18.8	735	126.7	129	131.3	
LA 24DA 34	344 x 285	344 x 285	4433	2 x 1440	112	246	10.1	13.5	6.7	15.1	796	150.6	153.3	156.1	
	344 X 203	364 x 285	5040	2 x 1920	149	328	7.6	10.4	7.0	12.5	796	153.3	157	174.4	

Туре	6-7 cond	8-9 cond	In	Alum.	lcw	lpk	Rdc 20°C			Z	P Losses @ In W/m	Eler	nent Weig	jht *Kg/m
	BxH (mm)	BxH (mm)	Α	N,L1,L2,L3 mm²	1 sec kA	kA	μΩ/m	μΩ/ m	μΩ/ m	μΩ/m	@ III VV/III	6 cond.	7 cond.	8/9 cond.
E single de	E single duct													
LB 08EA	138 x 120	168 x 120	1572	2 x 400	55	121	36.3	47.5	16.4	50.3	350	44.4	45.1	56.7
LB 12EA	138 x 160	168 x 160	1868	2 x 480	66	145	30.2	39.9	11.5	41.5	416	58.8	59.4	72.8
LD IZLA	130 X 100	100 X 100	2243	2 x 720	81	178	20.1	27.0	12.1	28.6	416	61.3	62.7	77
LB 16EA	138 x 200	168 x 200	2524	2 x 800	94	207	18.1	24.5	9.3	26.2	467	75.5	77	94.5
LD IOEA 13	130 X 200	100 X 200	2736	2 x 960	103	227	15.1	20.9	9.5	23.0	467	77.3	79.1	97.2

 $^{^{\}star}$ Total average weight of the system with junctions and standard supports.

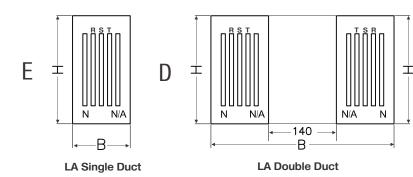





Copper betobar

Туре	3-4 cond	5 cond	In	Copper	lcw	lpk	Rdc 20°C	Rac OT	Х	Z	P Losses	Elen	nent Weig	ht *Kg/m
	BxH (mm)	BxH (mm)	Α	N,L1,L2,L3 mm²	1 sec kA	kA	μΩ/ m	μΩ/m	μΩ/m	μΩ/m	@ In W/m	3 cond.	4 cond.	5 cond.
E single d	uct													
LA 04EC	104 x 80	104 x 80	735	200	25	53	87.5	113.4	54.0	125.6	190	24.9	26.6	28.2
LA U4EC	104 X 60	104 X 60	816	240	30	63	72.9	94.9	54.7	109.5	190	25.9	27.9	29.9
LA 08EC	104 x 120	104 x 120	1141	320	33	69	54.7	71.8	32.1	78.6	280	37.9	40.6	43.2
LA UOLO	104 X 120	104 X 120	1266	400	42	88	43.8	58.3	32.8	66.9	280	39.9	43.2	46.5
			1478	480	43	90	36.5	49.2	23.0	54.3	322	51.6	55.8	59.8
LA 12EC	104 x 160	104 x 160	1635	600	54	119	29.2	40.2	23.6	46.6	322	54.8	59.8	64.8
			1770	720	65	143	24.3	34.3	24.2	41.0	322	57.8	63.8	69.7
LA 16EC	104 x 200	104 x 200	2033	800	63	139	21.9	31.2	18.5	36.2	387	69.8	76.4	83
LA TOEC	104 X 200	104 X 200	2220	960	75	165	18.2	26.6	19.0	32.7	387	73.8	81.7	90
LA 20EC	104 x 240	104 x 240	2402	1000	81	178	17.5	25.8	15.2	29.9	448	84.7	93	101.3
LA ZUEC	104 X 240	104 X 240	2600	1200	97	213	14.6	22.1	15.7	27.1	448	89.7	100	109.6
		104 x 285	2811	1200	86	189	14.6	20.1	12.9	23.9	475	100.9	110.9	120.8
LA 24EC	104 x 285	104 X 265	3044	1440	103	227	12.2	17.1	13.3	21.7	475	106.9	118.8	130.8
		114 x 285	3375	1920	120	264	9.1	13.3	14.1	19.4	475	118.8	134.7	157.5
Туре	6-7 cond	8-10 cond	l	Copper	lcw	lpk	Rdc 20°C	Rac OT	Х	Z	P Losses	Eler	nent Weig	ht *Kg/m
,,	BxH (mm)	BxH (mm)	In A	N,L1,L2,L3 mm²	1 sec kA	kA	μΩ/ m	μΩ/m	μΩ/m	μΩ/m	@ In W/m	6/7 cond.	8 cond.	10 cond.
D double	duct													
			3955	2 x 800	131	288	10.9	15.6	9.3	18.2	732	139.6	152.8	166.1
LA 16DC	344 x 200	344 x 200	4280	2 x 960	157	345	9.1	13.3	9.5	16.3	732	147.5	163.4	179.3
			4343	2 x 1000	133	293	8.8	12.9	7.6	15.0	735	169.5	186	202.6
LA 20DC	344 x 240	344 x 240	4700	2 x 1200	160	352	7.3	11.0	7.8	13.5	735	179.4	199.3	219.2
			5128	2 x 1200	128	282	7.3	10.0	6.5	11.9	796	201.9	221.8	241.6
LA 24DC	344 x 285	344 x 285	5554	2 x 1440	153	337	6.1	8.6	6.7	10.9	796	213.8	237.7	261.5
		364 x 285	6300	2 x 1920	204	449	4.6	6.7	7.0	9.7	796	237.6	269.5	314.9
T	0.7	0.0		0	1	ll-	D 1 00°0	D OT	· ·	7	Disease			
Type	6-7 cond BxH (mm)	8-9 cond BxH (mm)	In A	Copper N,L1,L2,L3	1 sec	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	X μΩ/m	Z μΩ/m	P Losses @ In W/m	6 cond.	nent Weig	8/9 cond
				mm²	kA							o oona.	, oona.	0,0 00110
E single d	uct													
LB 08EC	138 x 120	168 x 120	1795	2 x 320	60	132	27.3	35.9	16.0	39.3	350	76.8	90.8	96.1
LD OOLO	100 x 120	100 x 120	2000	2 x 400	75	165	21.9	29.2	16.4	33.5	350	86.1	101.4	108
			2373	2 x 480	90	198	18.2	24.6	11.5	27.2	416	108.6	128.1	136.1
LB 12EC	138 x 160	168 x 160	2625	2 x 600	100	220	14.6	20.1	11.8	23.3	416	122.5	144	153.9
	1	1 1												

 $[\]ensuremath{^{\star}}$ Total average weight of the system with junctions and standard supports.

168 x 200


LB 16EC

138 x 200

2810

3160

3420

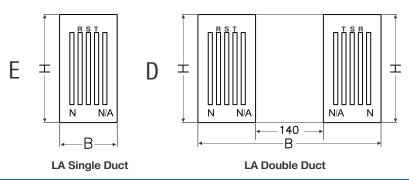

2 x 720

2 x 800

2 x 960

242

282

308

140

12.2

10.9

9.1

17.1

15.6

13.3

12.1

9.3

9.5


21.0

18.2

16.3

416

467



136.5

159

177.5

159.9

186.6

207.8


171.8

199.9

223.7

Straight Element

RE		L1 (mm)								
	Norm	Min	Max							
RE1	1000	550	1000							
RE2	2000	1001	2000							
RE3	3000	2001	3000							
RE4	4000	3001	4000							



Brazed Elbow Element

	-IL		L1			L2		L Total			
'	IL	Norm	Min	Max	Norm	Min	Max	Norm	Min	Norm	
	L.04/.		250	750		250			500		
HL1	L.08/.	500	270	730	500	270	600	1000	540	1000	
ПСІ	L.12/.	300	290	710	300	290			580		
	L.16/.		310	690		310			620		
	LA 20/.		330	670		330			660		
	LA 24/.		353	647		353			706		
	L.04/.			1750		250					
HL2	L.08/.		401	1730	1000	270	600	2000	1001	2000	
I ILZ	L.12/.	1500	401	1710	1000	290	000	2000	1001	2000	
	L.16/.			1690		310					
	LA 20/.	1000		1670		330		1500			
	LA 24/.			1647		353					



Bent Elbow Element


	НВ		L1			L2		L Total			
	ПВ	Norm	Min	Max	Norm	Min	Max	Norm	Min	Norm	
	LA3/5 (104mm)		262	738	500	262	738		524		
HB1	LA3/5 (114mm)	500	267	733		267	733	1000	534	1000	
	LB6/7	27	279	721		279	721	1000	558		
	LB8/9		294	706		294	706		588		
	LA3/5 (104mm)	1500	262	1738		262	1738	2000			
	LA20-3/5 (104mm)	1000	262	1738	500	262 17	1738	1500	1001	2000	
HB2	LA24-3/5 (114mm)	1000	267	1733	300	267	1733	1300	1001	2000	
	LB6/7	1500	279	1721		279	1721	2000			
	LB8/9	1500	294	1706		294	1706	2000			





Brazed 'Z' Element

	71		L1			L2			L3		L	Total	
	ZL	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
	L.04/.	450	250	705			500		250			545	
	L.08/.	430	270	685	300	45	480		270		1000	585	1000
ZL1	L.12/.	410	290	665	300		460		290		1000	625	
	L.16/.	390	310	645			440		310			665	
	LA 20/	. 370	330	625			420		330			705	
	LA 24/	. 360	353	595	280		397		360			751	
	L.04/.	1250	250	1705			560		250				
	L.08/.	1230	270	1730			540		270		2000		2000
ZL2	L.12/.	1210	290	1710			520		290				
	L.16/.	1190	310	1690	500	45	500		310			1001	
	LA 20/	670	330	1670			500		330		1500		1500
	LA 24/	. 640	353	1640			500		360		1300		1300




Bent 'Z' Element

	70		L1		L2		L3		L Total				
	ZB	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
	LA3/5 (104mm)		262	638	633		476		262	638		624	
ZB1	LA3/5 (114mm)	350	267	633		100	466	350	267	633	1000	634	1000
	LB6/7	330	279	621		100	442	330	279	621	1000	658	
	LB8/9		294	606			412		294	606		688	
ZB2	LA3/5 (104mm)	1000	262	1638			1476		262	1638	2000		
	LA20-3/5 (104mm)		262	1638			1476		262	1638	1500		
	LA24-3/5 (114mm)	500	267	1633	621	100	1466	500	267	1633	1300	1001	2000
	LB6/7	1000	279	1621			1442		279	1621	2000		
	LB8/9	1000	294	1606			1412		294	1606			




Expansion Element

EX	L1 (mm)						
EX1	Norm	Min	Max				
	1000	1000	1000				




Brazed T Element

TL		L1			L2		L3			L Total			
	I L	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
	L.04/.		250	500		250	500		250			750	
TL1	L.08/.		270	460		270	460	270	270			810	
ILI	L.12/.	330	290	420	330	290	420	340	290	600	1000	870	1000
	L.16/.		310	380		310	380		310			930	
	LA20/.		330	340		330	340		330			990	
	L.04/.		250	1500		250	1500		250				
	L.08/.		270	1460		270	1460		270				
TL2	L.12/.	1000	290	1420	500	290	1420	500	290	600	2000	1001	2000
	L.16/.		310	1380		310	1380		310				
	LA20/.		330	1340		330	1340		330				
	LA24/.	500	353	1294		353	1294		353		1500	1059	1500



Bent T Element


	ТВ		L1			L2			L3		L	Tota	ı
	16		Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
TB2	LA04-3/5		380			380						1040	
	LA08-3/5		420			420			280		1120		
	LA12-3/5		510			510						1300	
	LA16-3/5		570			570					1420		
	LA20-3/5 (104mm)		610			610			280			1500	
	LA24-3/5 (104mm)		650			650			280			1580	
	LA24-3/5 (114mm)		655			655			285			1595	
	LB04-6/7		380			380					1055		
	LB08-6/7		440			440			295		1175		
	LB12-6/7		510			510			293			1315	
	LB16-6/7		570			570						1435	
	LB04-8/9		420			420						1150	
	LB08-8/9		460			460			310			1230	
	LB12-8/9		570			570						1450	
	LB16-8/9		610			610						1530	






Double Elbow Element


	VD MI		L1			L2			L3			L Total	
	XR/XL	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
	La04- 3/5			558		192	488		250	546		704	
	LA08-3/5		262	518		212	468		270	526		744	
	LA12-3/5	330		478		232	448	340	290	506		784	
	LA16-3/5			438		252	428		310	486		824	
	LA20-3/5 (104mm)			398		272	408		330	466 443		864	
	LA24-3/5 (104mm)	310		352	330	295	385	360	353		1000	910	1000
VD4/	LA24-3/4 (114mm)	310	267	347	330	300	385	360	353	438	1000	915	1000
XR1/ XL1	LB04-6/7			541		209	471		250	512		738	
71=1	LB08-6/7		070	501		229	451		270	492		778	
	LB12-6/7		279	461		249	431		290	472		818	
	LB16-6/7	330		421		269	411	340	310	452		858	
	LB04-8/9	330	294	526		224	456		250	482		768	
	LB08-8/9			486		244	436		270	462		808	
	LB12-8/9			446		264	416		290	442		848	
	LB16-8/9			406		284	396		310	422		888	
	LA04- 3/5			1558		192	1488		250		2000		
	LA08-3/5			1518		212	1468		270				
	LA12-3/5		262	1478	1000	232	1448		290				
	LA16-3/5		202	1438		252	1428		310				
	LA20-3/5 (104mm)			1398		272	1408		330				
	LA24-3/5 (104mm)			1352	500	295	1385		353		1500		
XR2/	LA24-3/5 (114mm)			1347		300	1385		353				
XL2	LB04-6/7	500		1541		209	1471	500	250	600		1001	2000
	LB08-6/7			1501		229	1451		270				
	LB12-6/7		279	1461		249	1431		290				
	LB16-6/7			1421	1000	269	1411		310				
	LB04-8/9			1526	1000	224	1456		250		2000		
	LB08-8/9		004	1486		244	1436		270				
	LB12-8/9		294	1446		264	1416		290				
	LB16-8/9			1406		284	1396		310				






Terminal Elements

	L1** (mm)	P2* (mm)
	Norm	Norm
NG	500	500




	L1** (mm)						
	Norm	Min	Max				
AH1	500	400	1000				


	L1** (mm)						
	Norm	Min	Max				
AG1	500	400	1000				




'NG' Type Standard Terminal Element



'AF' Type



'AH' Type



^{**}L1standard dimensions for terminal element with 4 poles, for all other configurations (3 or 5 poles) dimensions will be as per equipment lay-out, depending on the geometry of the terminal head

^{*}P2dimensions will be as per equipment lay-out, depending on the geometry of the terminal head.




		L1** (mm)						
	Norm	Min	Max					
AJ1	500	400	1000					


	L1** (mm)						
	Norm	Min	Max				
AO1	500	400	1000				

	L1** (mm)						
	Norm	Min	Max				
AC1	500	400	1000				
AC2	1500	1001	2000				


	L1** (mm)						
	Norm	Min	Max				
AP1	500	400	1000				
AP2	1500	1001	2000				




'AJ' Type



'AO' Type



'AC' Type



'AP' Type

^{**}L1standard dimensions for terminal element with 4 poles, for all other configurations (3 or 5 poles) dimensions will be as per equipment lay-out, depending on the geometry of the terminal head


^{*}P2dimensions will be as per equipment lay-out, depending on the geometry of the terminal head.


Terminal Elements

	L1** (mm)									
	Norm	Min	Max							
AE1	1500	400	1000							
AE2	1500 1001 2000									


		L1** (mn	٦)						
	Norm	Min	Max						
DGD1	500 480 100								

	L1** (mm)									
	Norm	Min	Max							
DGF1	500 480 1000									







'AE' Type



'DGD' Type



'DGF' Type



'DJD' Type

^{**}L1standard dimensions for terminal element with 4 poles, for all other configurations (3 or 5 poles) dimensions will be as per equipment lay-out, depending on the geometry of the terminal head

^{*}P2dimensions will be as per equipment lay-out, depending on the geometry of the terminal head.




Joints for Low Voltage


Result Cast Assemble ST26 Joint ST27 Joint

ST29 Joint


Spring Supports

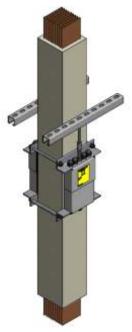


Closed Spring Support in Hanging Arrangement

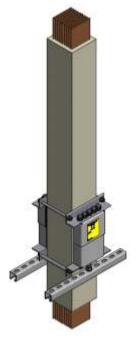

Closed Spring Support in Standing Arrangement

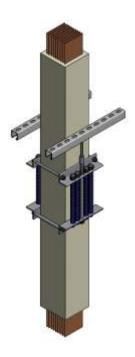


Open Spring Support in Hanging Arrangement

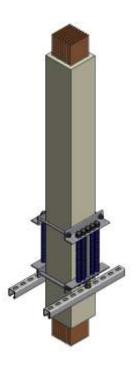


Open Spring Support in Standing Arrangement



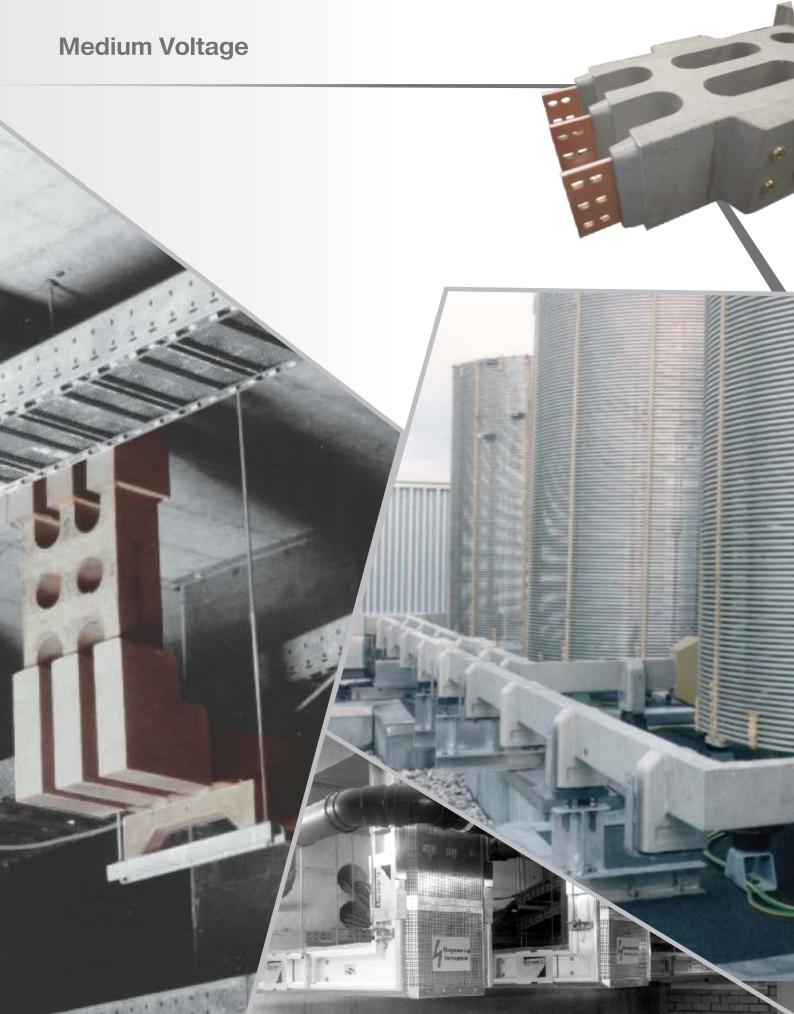

Applications

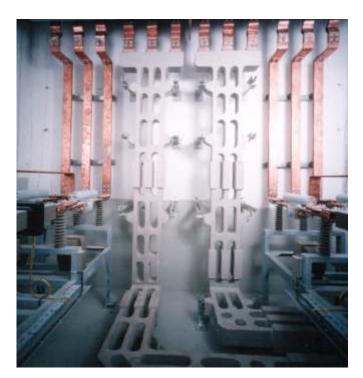









Technical Specifications for Medium Voltage

Compliance Standard	IEC 62271
Independent Certification Authority	KEMA, MPA (Germany), ISSeP, ASTA, IPH
Type of Series	SH & PH Series
Dakinana	SH Series
Ratings	Aluminium - 1368A to 1645A Copper - 1345A to 2030A
	PH Series Unshielded Aluminium- 1377A to 4967A Copper - 1939A to 6140A
	PH Series Shielded Aluminium- 1193A to 4303A Copper - 1680A to 5391A
Rated Operating Voltage	SH Series - 3.6 kV to 12 kV PH Series - 3.6 kV to 17.5 kV
Rated Frequency	50Hz
Busbar Material	Copper 99.9% Pure ETP grade Aluminium, 99.5% Pure grade
Insulation	CLASS 'B' (130°C)
Degree of Protection	IP67 as per IEC 60529
Mechanical Impact	IK.10 as per IEC 62262 DIN 52453
Conditions of use	Altitude upto 5000m, indoor as well as outdoor Ambient temperature ; -50 $^{\circ}$ C / + 60 $^{\circ}$ C Ambient Humidity : 0% - 100%



SH Series


Aluminium betobar

Туре	B x H (mm)	B' x H' (mm)	In A	Alum. L1,L2,L3 mm²	Icw 1 sec kA	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	X μΩ/m	Z μΩ/m	P Losses @ In W/m	Element Weight *Kg/m
3.6-12KV**, 50 Hz												
			1368	800	38	95	36.3	48.0	79	92.4	270	57.6
SH 10A	160 x 140	250 x 195	1511	1000	47	118	29.0	39.4	77.9	87.3	270	58.6
			1645	1200	57	143	24.2	33.0	76.8	83.7	270	59 . 5

Copper betobar

Туре	B x H (mm)	B' x H' (mm)	In A	Copper L1,L2,L3 mm ²	Icw 1 sec kA	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	X μΩ/m	Z μΩ/m	P Losses @ In W/m	Element Weight *Kg/m	
3.6-12K\	3.6-12KV, 50 Hz												
			1345	480	48	120	36.5	48.1	102.9	113.6	261	58.3	
SH 06C	160 x 100	250 x 155	1485	600	60	150	29.2	39.4	101.1	108.5	261	63.2	
			1616	720	72	180	24.3	33.3	99.3	104.7	261	68.2	
			1718	800	52	130	21.9	30.3	79	84.6	270	86.9	
SH 10C	160 x 140	250 x 195	1882	1000	64	160	17.5	25 . 3	77.9	81.9	270	95.2	
		2030	1200	77	193	14.6	21.7	76.8	79.8	270	103.4		

 $^{{}^\}star\!\text{Total}$ average weight of the system with junctions and standard supports.

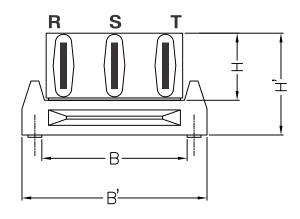



SH Series - Element Restricted Dimensions


Straight Element

RE	L1 (mm)								
nL.	Norm	Min	Max						
RE1	1000	350	1000						
RE2	2000	1001	2000						
RE3	3000	2001	3000						
RE4	4000	3001	4000						




Brazed Elbow Element

	HL	L	.1 (mm	1)		L2			L-Total		
	пь	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	
	SH06	500	260	740	500	260	000	1000	520	1000	
HL1	SH10	500	280	720	500	280	600	1000	560	1000	
	SH06	1500	401	1740	500	260	000	0000	1001	0000	
HL2	SH10	1500 4		1720	500	280	600	2000	1001	2000	




Bent Elbow Element

	НВ	L	.1 (mm	1)		L2		L-Total			
TID		Norm	Min Max		Norm	Min	Max	Norm	Min	Max	
HB1	SH06	500	290	710	500	290	710	1000	580	1000	
ПВІ	SH10	300	290	710	500	290	710	1000	580	1000	
HB2	SH06	500	290	1710	500	290	1710	2000	1001	2000	
ПВ2	SH10	300	290	1710	500	290	1710	2000	1001	2000	



Brazed 'Z' Element

	ZL	L1 (mm)			L2			L3			L Total		
	ZL	Norm	Min	Max	Norm	Min	Max	Norm Min I		Max	Norm	Norm Min M	
ZL1	SH06	440	260	695	300	45	560		260		1000	565	1000
ZLI	SH10	420	280	675	300	40	520		280			605	1000
ZL2	SH06	1240	260	1695	500	45	560		260		2000	1001	2000
ZL2	SH10	1220	280	1675	500	45	520	280		2000	1001	2000	



^{*}Depending on the geometry of termination head flange.


Bent 'Z' Element

7	ZB	L1 (mm)			L2			L3			L Total		
25		Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
ZB1	SH06	350	290	610	300	100	420	350	290	610	1000	680	1000
ZDI	SH10	330	290	610	300	100	420	330	290	610	1000	680	1000
700	SH06	1000	290	1610	E00	100	1420	500	290	1610	2000	1001	2000
ZB2	SH10	1000	290	1610	500 100	1420	500	290	1610	2000	1001	2000	




Brazed 'T' Element

-	ΓL	L1 (mm)				L2			L3			L Total		
1		Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	
TL1	SH06	330	260	480	330	260	480	340	260	480	1000	780	1000	
ILI	SH10	330	280	440	330	280	440	340	280	440	1000	840	1000	
TLO	SH06	500	260	1480	500	260	1480	500	260	1480	2000	1001	2000	
TL2	SH10	500	280	1440	500	280	1440	500	280	1440	2000	1001	2000	




Bent 'T' Element

ТВ		L1 (mm)		L2		L3		L Total				
		Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min
TB2	SH06		460			460		045		·	1235	
1BZ	SH10	570		570			315			1455		



Expansion Element


FX	L1 (mm)				
EX	Norm	Min	Max		
EX1	1000	1000	1000		






Double Elbow Element

XR/XL		L	L1 (mm)		L2		L3		L Total				
ΔΠ	//L	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
XR1/	SH06	330	290	450	330	290	450	340	260	420	1000	840	1000
XL1	SH10	330	290	430	330	290	430	340	280	420	1000	860	1000
XR2/	SH06	500	290	1450	1000	290	1450	500	260	600	2000	1001	2000
XL2 SH10	SH10	500	290	1430	1000	290	1430	500	280	000	2000	1001	2000







Terminal Elements


	L1				
	Norm	Min	Max		
AE1	500	400*	1000		
AE2	1500	1001	2000		

	L1				
	Norm	Min	Max		
AP1	500	400*	1000		
AP2	1500	1001	2000		

	L1			
	Norm	Min	Max	
AC1	500	400*	1000	
AC2	1500	1001	2000	







Terminal Elements

	L1			
	Norm	Min	Max	
AG1	500	400*	1000	


	L1				
	Norm	Min	Max		
AJ1	500	400*	1000		


	L1				
	Norm	Min	Max		
AM1	500	400*	1000		

	L1			
	Norm	Min	Max	
AH1	500	400*	1000	


		L1	
	Norm	Min	Max
AO1	500	400*	1000

^{*}P2 dimension will be as per the equipment layout depending on the geometry of the terminal head.







'AJ' Type



'AH' Type



'AM' Type





PH Series


Unshielded Aluminium betobar


Туре	B x H (mm)	B' x H' (mm)	In A	Alum. L1,L2,L3 mm²	Icw 1 sec kA	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	Χ μΩ/ m	Z μΩ/m	P Losses @ In W/m	Element Weight *Kg/m
3.6-7.2-12-17.5KV, 50 Hz												
PH 10A	301 x 140	390 x 215	1377	400	29	73	72.5	92.1	130.6	159.8	521	59.7
PH IUA	301 X 140	390 X 215	1675	600	44	110	48.3	62.2	129.5	143.7	521	60.3
			1680	720	32	80	40.3	52.9	119.5	130.7	541	82.1
PH 12A	322 x 170	390 x 245	1918	960	43	108	30.2	40.5	118.5	125.2	541	82.8
			2118	1200	53	133	24.2	33.2	117.6	122.2	541	83.5
DUITO	200 4 010	390 x 285	2586	1280	55	138	22.7	31.5	103.4	108.1	628	102.6
PH 16A	322 x 210	390 X 265	2854	1600	69	173	18.1	25.8	102.7	105.9	628	103.5
DLLOOA	200 000	200 205	3131	2 x 800	49	123	18.1	24.0	92.1	95.2	706	127.1
PH 20A	322 x 260	390 x 335	3461	2 x 1000	61	153	14.5	19.7	91.5	93.6	706	128.2
			4079	2 x 1200	81	203	12.1	16.6	82.7	84.3	829	148.2
PH 24A	322 x 300	390 x 375	4413	2 x 1440	98	245	10.1	14.2	82.2	83.4	829	149.6
			4967	2 x 1920	130	325	7.6	11.2	81.2	82.0	829	152.4

Shielded Aluminium betobar

Туре	B x H (mm)	B' x H' (mm)	In A	Alum. L1,L2,L3 mm²	Icw 1 sec kA	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	X μΩ/m	Z μΩ/m	P Losses @ In W/m	Element Weight *Kg/m
3.6-7.2-1	12-17.5KV,	, 50 Hz										
PH 10AS	301 x 140	500 x 252	1193	400	29	73	72.5	92.1	130.6	159.8	391	76.7
FH IUAS	301 X 140	300 X 232	1451	600	44	110	48.3	62.2	129.5	143.7	391	77.2
			1565	720	32	80	40.3	52.9	119.5	130.7	458	100.8
PH 12AS	322 x 170	522 x 342	1788	960	43	108	30.2	40.5	118.5	125.2	458	101.5
			1974	1200	53	133	24.2	33.2	117.6	122.2	458	102.2
DUAGAG	200 010	500 040	2240	1280	55	138	22.7	31.5	103.4	108.1	472	122.3
PH 16AS	322 x 210	522 x 342	2472	1600	69	173	18.1	25.8	102.7	105.9	472	123.3
DULOGAG	000 000	F00 000	2712	2 x 800	49	123	18.1	24.0	92.1	95.2	531	127.1
PH 20AS	322 x 260	522 x 392	2998	2 x 1000	61	153	14.5	19.7	91.5	93.6	531	128.2
			3533	2 x 1200	81	203	12.1	16.6	82.7	84.3	622	173.9
PH 24AS	322 x 300	522 x 432	3823	2 x 1440	98	245	10.1	14.2	82.2	83.4	622	175.2
			4303	2 x 1920	130	325	7.6	11.2	81.2	82.0	622	178

 $[\]ensuremath{^{*}}$ Total average weight of the system with junctions and standard supports







PH Series


Unshielded Copper betobar


Туре	B x H (mm)	B' x H' (mm)	In A	Copper RST mm²	Icw 1 sec kA	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	Χ μΩ/ m	Z μΩ/m	P Losses @ In W/m	Element Weight *Kg/m
3.6-7.2-12-17.5KV, 50 Hz												
DU 100	201 v 140	200 v 015	1939	500	50	125	35.0	46.2	130.0	138.0	521	71
PH 10C	301 x 140	390 x 215	2100	600	60	150	29.2	39.4	129.5	135.4	521	73 . 5
PH 12C	322 x 170	390 x 245	2114	720	44	110	24.3	33.2	119.5	124.0	541	98
			2849	960	57	143	18.2	25.8	104.1	107.2	628	122.8
PH 16C	322 x 210	390 x 285	3209	1280	75	188	13.7	20.3	103.4	105.4	628	130.7
			3523	1600	94	235	10.9	16.9	102.7	104.1	628	138.7
DILLOGO	200 000	200 205	3939	2 x 800	67	168	10.9	15.1	92.1	93.3	706	162.2
PH 20C	322 x 260	390 x 335	4323	2 x 1000	83	208	8.8	12.6	91.5	92.4	706	172.1
			4613	2 x 960	77	193	9.1	12.9	83.2	84.2	829	189
DULOAC	200 + 200	200 1 275	5063	2 x 1200	96	240	7.3	10.7	82.7	83.4	829	200.9
PH 24C	322 x 300 390 x 375	5446	2 x 1440	116	290	6.1	9.3	82.9	83.4	829	212.8	
			6140	2 x 1920	154	385	4.6	7.3	81.2	81.5	829	236.7

Shielded Copper betobar

Туре	B x H (mm)	B' x H' (mm)	In A	Copper RST mm²	Icw 1 sec kA	lpk kA	Rdc 20°C μΩ/m	Rac OT μΩ/m	X μΩ/m	Z μΩ/m	P Losses @ In W/m	Element Weight *Kg/m
3.6-7.2-1	2-17.5KV,	50 Hz										
PH 10CS	301 x 140	500 x 252	1680	500	50	125	35.0	46.2	130.0	138.0	391	87.9
FH 1003	301 X 140	300 X 232	1819	600	60	150	29.2	39.4	129.5	135.4	391	90.4
PH 12CS	322 x 170	522 x 342	1970	720	44	110	24.3	33.2	119.5	124.0	458	116.6
PH 1203			2468	960	57	143	18.2	25.8	104.1	107.2	472	142.5
PH 16CS	322 x 210	522 x 342	2780	1280	75	188	13.7	20.3	103.4	105.4	472	150.4
PH 1003			3052	1600	94	235	10.9	16.9	102.7	104.1	472	158.4
PH 20CS	322 x 260	522 x 392	3412	2 x 800	67	168	10.9	15.1	92.1	93.3	531	184.8
PH 2003	322 X 200	322 X 392	3745	2 x 1000	83	208	8.8	12.6	91.5	92.4	531	194.7
			3996	2 x 960	77	193	9.1	12.9	83.2	84.2	622	214.6
DI 0400	322 x 300	522 x 432	4386	2 x 1200	96	240	7.3	10.7	82.7	83.4	622	226.6
PH 24CS	322 X 300	322 X 432	4718	2 x 1440	116	290	6.1	9.3	82.9	83.4	622	256.4
			5319	2 x 1920	154	385	4.6	7.3	81.2	81.5	622	262.3

 $[\]ensuremath{^{*}}$ Total average weight of the system with junctions and standard supports








PH Series - Elements


Straight Element


RE		L1 (mm)	
ne ne	Norm	Min	Max
RE1	1000	550	1000
RE2	2000	1001	2000
RE3	3000	2001	3000
RE4	4000	3001	4000

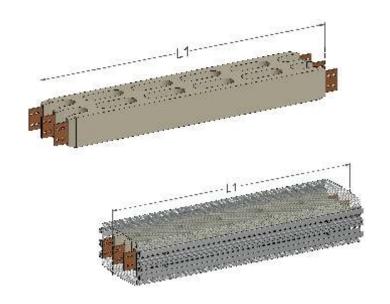

Brazed Elbow Element


	11		L1			L2		L Total			
	IL	Norm	Min	Max	Norm	Min	Max	Norm	Min	Norm	
	PH10	650	360			350			710		
	PH12	595	375			405			780		
HL1	PH16	575	395	1000		425		1000	820	1000	
	PH20	550	420			450			870		
	PH24	530	440			470			910		
	PH10	1650	651			350					
	PH12	1595	596			405					
HL2	PH16	1575	576	2000		425		2000	1001	2000	
	PH20	1550	551			450					
	PH24	1530	531			470					

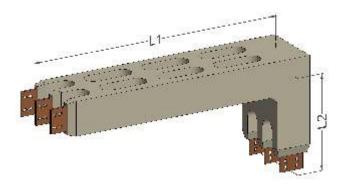


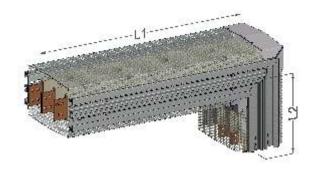

Bent Elbow Element


	ID.		L1			L2		L Total			
Н	IB	Norm	Min	Max	Norm	Min	Max	Norm	Min	Norm	
	PH10		370	630		370	630		740		
	PH12		380	620		380	620		760		
HB1	PH16	500	380	620	500	380	620	1000	760	1000	
	PH20		380	620		380	620		760		
	PH24		380	620		380	620		760		
	PH10		370	1630		370	1630				
	PH12		380	1620		380	1620				
HB2	PH16	1500	380	1620	500	380	1620	2000	1001	2000	
	PH20		380	1620		380	1620				
	PH24		380	1620		380	1620				

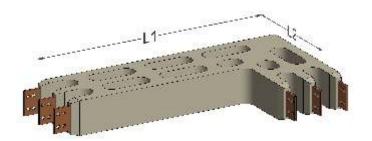




Bent 'Z' Element

_	7D		L1			L2			L 3		L Total		
	ZB	Norm	Min	Max	Norm	Min	Max	Norm	Min	Norm	Norm	Min	Norm
	PH10		370	430		200	260		370	430		940	
	PH12		380	575		45	240		380	575		805	
ZB1	PH16	400	380	575	200	45	240	400	380	575	1000	805	1000
	PH20		380	575		45	240		380	575		805	
	PH24		380	575		45	240		380	575		805	
	PH10		370	1430		200	1260		370	1430			
	PH12		380	1575		45	1240		380	1575			
ZB2	PH16	1000	380	1575	500	45	1240	500	380	1575	2000	1001	2000
	PH20		380	1575		45	1240		380	1575			
	PH24		380	1575		45	1240		380	1575			









Brazed 'T' Element


_			L1		L2			L 3			L Total		
Т	L	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max
	PH10	650	360	1290		360	1290		350			1070	
	PH12	595	375	1220		375	1220		405			1155	
TL2	PH16	575	395	1180	500	395	1180		425		1500	1215	2000
	PH20	550	420	1130		420	1130		450			1290	
	PH24	530	440	1090		440	1090		470			1350	

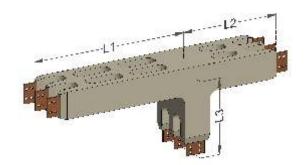





Double Elbow Element

V	XR / XL		L1			L2			L 3			L Total		
	H / XL	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	Norm	Min	Max	
	PH10	650	370	1339		311	1280		350			1031		
	PH12	595	380	1259		336	1215		405			1121		
XR2/	PH16	575	380	1219	500	356	1195		425		1500	1161	2000	
XL2	PH20	550	380	1169	,	381	1170		450			1211		
	PH24	530	380	1129		401	1150		470			1251		

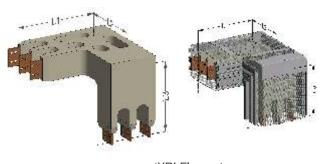







'XR' Element

'XL' Element

Expansion Element


EX		L1 (mm)	
LA	Norm	Min	Max
EX1	1000	1000	1000






Terminal Elements

			L1	
		Norm	Min	Max
A	C1	500	500	1000
A	02	1500	1001	2000




'AC' Type




'AC' Type (Shielding)

	L1								
	Norm	Min	Max						
AE1	500	500	1000						
AE2	1500	1001	2000						



'AE' Type




'AE' Type (Shielding)

	L1								
	Norm	Min	Max						
AG1	500	450	1000						



'AG' Type




'AG' Type (Shielding)


^{*}P2 dimension will be as per the equipment layout depending on the geometry of the terminal head.



	Norm	Min	Max
AJ1	500	450	1000




'AJ' Type



'AJ' Type (Shielding)

		L1						
	Norm Min Max							
AM1	500	450	1000					



'АМ' Туре

Max

1000


L1 Min

450

Norm


500

AO1



'AM'	Lvpe	(Shielding)


'AO' Type	



'AO' Type (Shielding)

^{*}P2 dimension will be as per the equipment layout depending on the geometry of the terminal head.

Joints for Medium Voltage

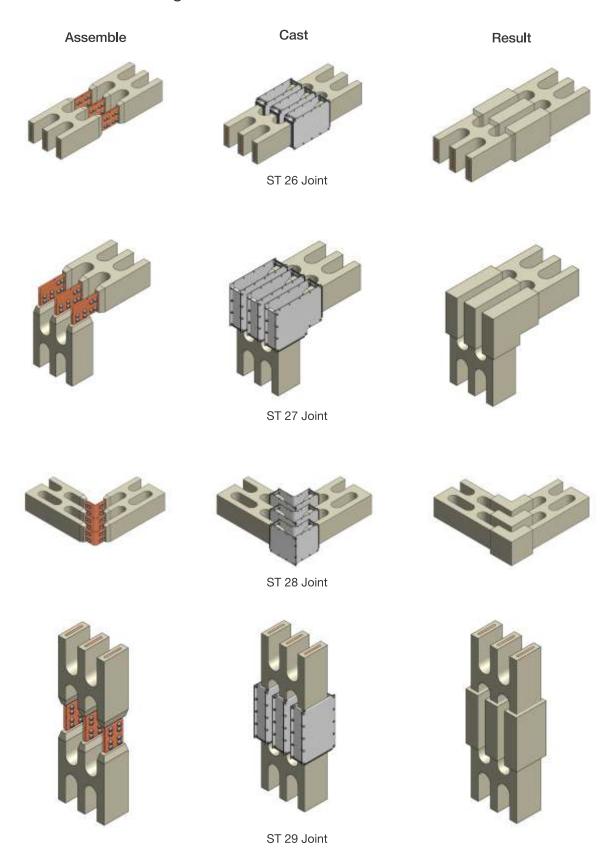




General Information


- Design Fundamentals
- Termination Details
- Bushings up till S120
- Chemical Resistance
- Standard Work Tests
- Reference Lists



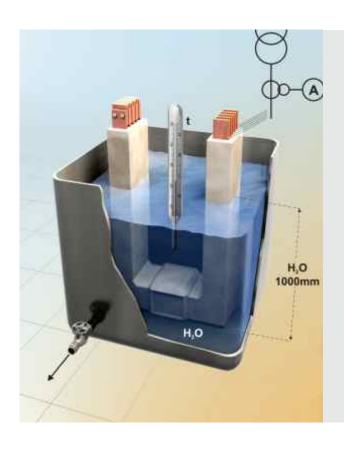

Combined test
Heat run - Immersion
6 Cycles - Total 2592 hours

Fire resistance to IEC 60331 3 hours flame contact at 750°C E30 to E120 as per NBN 713020 add 3 (Lab Luik Belgium)

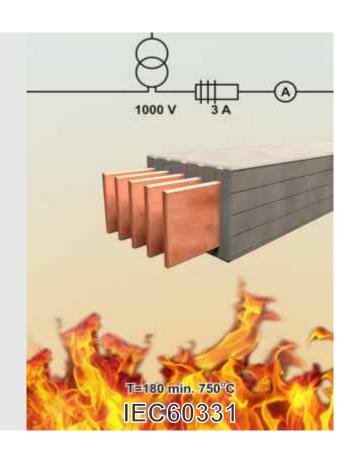



General Low Voltage/Medium Voltage Design Fundamentals

1. IEC Standard - Temperature Limits

For LV design temperature rise is as per IEC 61439-1 & 6 For MV design temperature rise is as per IEC 62271

2. Weights

The weights of the bottopast for the LV-types are the average weights as indicated in the tables including the junction and the casting mix per system length of 2 m. For MV-type the supporting insulators and any possible screening is included. If partitions for a full phase segregation are needed they have to be added as extra weight.

3. System impedance

All impedances have been calculated with physical values:

For copper:

Specific resistance at 20° C = $0.0175 \cdot \text{mm}^2/\text{m}$ Conductivity $57 \cdot \text{MS/m}$ Temperature coefficient = $0.00392 \cdot 1/\text{K}$

Standard EN 13601 (2002)

For aluminium:

Specific resistance at 20° C = 0.029Ω .mm²/m Conductivity 35.4 MS/m

Temperature coefficient = 0.0041/K

Standard En7552 (1997)

4. Maximum voltage

betobar is designed for a maximum voltage of 17.5 kV. Rated voltage 12kV & above is provided with self - supporting safety screen.

5. Short circuit

LV	MV	I_{∞} values in the technical data
Icw	lk	Symmetrical short circuit current (1 second effective value if no further indications)
lpk	lp	Asymmetrical (dynamic) short circuit current (peak value)

The betobase busbars type tested reports of the official and independent laboratories (mostly at KEMA, IPH, ASTA) defines the I_{sc} rating.

Phase distance and support-shoulder distance can be chosen for each project taking into account the production possibilities. Consult Eta-com or your betobage agent on this matter.

6. Correction factors 60 Hz

Current rating for a power frequency of 60 Hz

		copper height [mm]										
	40	40 60 80 100 120 160 200										
LV	0.998		0.995		0.989	0.988	0.988	0.988				
MV		0.993	0.986	0.986	0.982	0.982	0.982	0.982				

		aluminium height [mm]											
	40	200	240										
LV	1.000		0.997		0.996	0.989	0.988	0.988					
MV		0.995	0.994	0.994	0.987	0.982	0.982	0.982					

7. Voltage drop calculation

Generally long busduct connections have to be checked for voltage drop with the following formula: $\Delta U = \sqrt{3} \times I_s \times a \times L \times (Raxcos\varphi + XxsIn\varphi) \times 10^{-6}V$.

Whereby: $\Delta U = \text{voltage drop (between phases)}$ [Volts] Is = Normal Full Load Current [Amps]

a = current distribution factor¹ see graph.below

L = total busduct length [m] Rac = A. C. Resistance at operating temperature²) $[\mu\Omega/m]$


 $cos\phi$ = power factor

X = reactance (mean value³ [μΩ/m]

sinφ = reactive factor (= $\sqrt{1-cosφ2}$)

Notes:

- 1) For distribution lines, the max. average load current which can be indicated as a % of the full load has to be used in this calculation
- 2) For 60 Hz: $X \cdot 6/5 = X \cdot 1,2$



8. Phase sequence

Phase sequence in documentation and product documents:

is indicated as R S T to be equal to R Y B or L1 L2 L3

9. General

For all information or technical calculation, please consult Eta-com or your betobage agent.



Chemical Resistance betobar Insulation

The results of the tests carried out at the betobage laboratories are given in the table below. They are based upon the conditions prevailing during these tests: carried out at 20°C and fully immersed for at least one year.

The details given in this list have been prepared with maximum care and to the best of our knowledge. However, we cannot assume liability for usage in very specific cases.

Each individual application has to be considered by the factory.

Chamical amenta			Results	
Chemical agents		Е	G	F
Boric acid	H ₃ BO ₃	Х		
Hydrochloric acid 10%	HCI			Х
Citric acid 10%	C ₃ H ₄ OH(CO ₂ H) ₃			Х
Lactic acid 10%	CH₃-CHOH-CO₂H			Х
Alcohol (ethyl-)	C₂H₅OH		X	
Beer		Х		
Ketone (acetone)	H ₃ CCOCH ₃			Х
Calcium chioride 50%	CaCl ₂	Х		
Liquid combustibles (petrol, oil,)		Х		
Water (distilled)	H ₂ O	Х		
Water (mineral)		Х		
Esters			×	
Ether	C ₂ H ₅ OC ₂ H ₅			Х
Formalin 37%	НСОН		×	
Glycerin			X	
Lubricating grease and oil		Х		
Greases and oil		Х		
Vegetable oil		X		
Aliphatic hydrocarbide (petroleumether)	C_5H_{12}	Х		
Aromatic hydrocarbide (toluene)	C ₅ H ₁₂			Х
Chloride carbon	CCI ₄			Х
Ammonium hydroxide 10%	NH₄OH		X	
Ammonium hydroxide 30%	NH₄OH			X
Millk (fresh and sour)				X
Soda-lime 10%	NaOH		X	
Soda-lime 50%	NaOH		X	
Blood		Х		
Soap and detergents		Х		
Sugar (saturated solution)		X		
Urine		X		

E = Excellent, suitable even for uninterrupted and prolonged exposure

G = Good, suitable for prolonged exposure

F = Fair, suitable for repeated but brief exposures


In the event of consultations or enquiries regarding chemical resistance, please always state the following:

- 1. The chemical material, if possible with formula, and in case of trade names, the manufacturer.
- 2. The mixing ration with a solvent, usually water.
- 3. The temperature, including temperature changes with the corresponding time intervals.
- 4. Period of exposure.


Examples For LV Terminations

Standard flexible connection with bellow and laminated flexibles

- 1. betobar
- 2. Flange
- 3. Bellow
- 4. Flexibels
- 5. Switchgear or connection box
- 6. Terminals

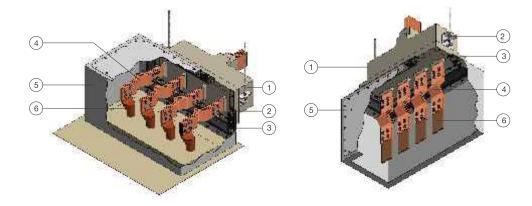


Bottom entry: with flexibles or shunts and bottom plate IP class 54

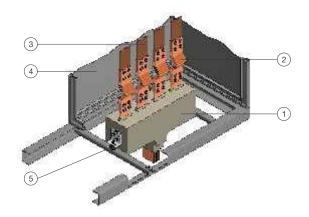


- 1. betobar
- 2. Flexibels
- 3. Terminals
- 4. Switchgear panel
- 5. Support

Terminations with bellow



Terminations with membrane







Examples For MV Terminations


Standard flexible connection with bellow and laminated flexibles

- 1. betobar
- 2. Flange
- 3. Bellow
- 4. Flexibels
- 5. Switchgear or connection box
- 6. Terminals




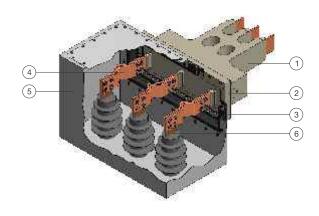

Terminations with bellow

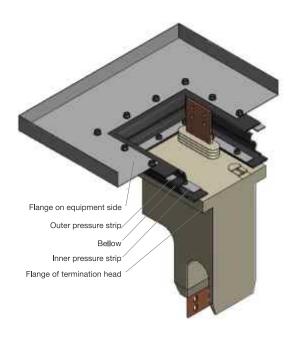


Terminations with membrane

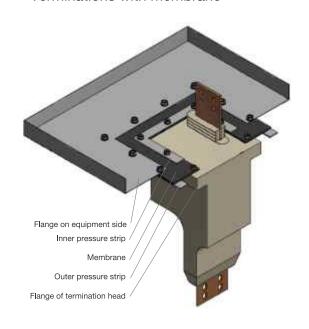


Wall Bushing Till S120

Low Voltage Systems

- 1. Fireproof wall or floor
- 2. Promaxon plate 20mm, 2 staggered layers
- 3. Promaxon plate 25mm
- 4. Rockwool, density>=100kg/m³
- 5. Steelbolt anchor
- 6. Promaseal and promacol

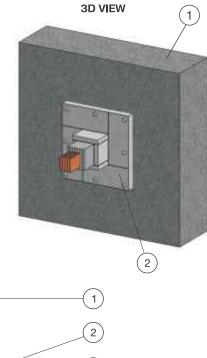

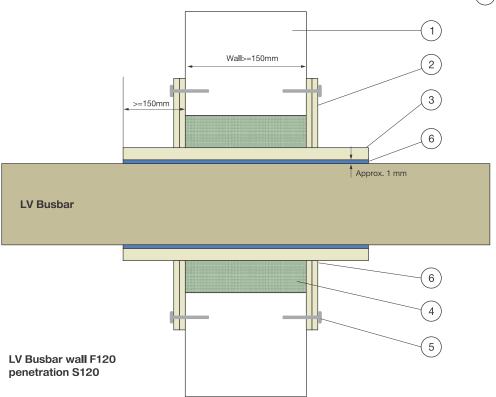

LV Busbar wall F120 penetration S90

LV Busduct with Copper conductor

LV Busduct with Aluminium Conductor S120


Floor penetration Alu + Cu = S120



Wall Bushing Till S120

Medium Voltage Systems

- 1. Fireproof wall or floor
- 2. Promaxon plate 20mm, 2 staggered layers
- 3. Promaxon plate 25mm
- 4. Rockwool, density>=100kg/m³
- 5. Steelbolt anchor
- 6. Promaseal and promacol

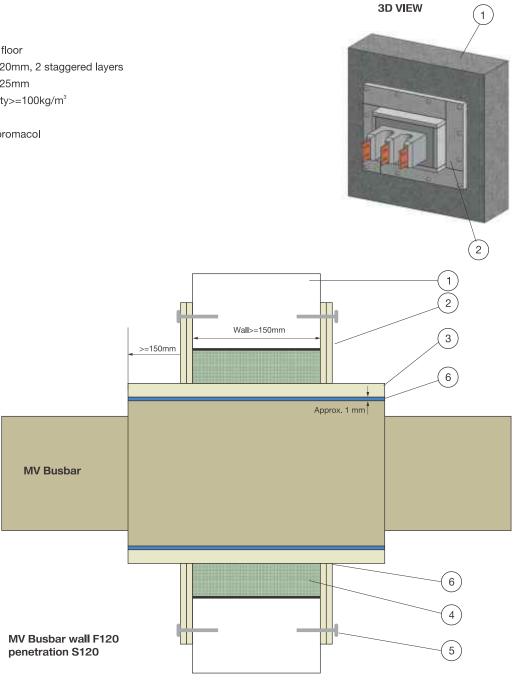

MV Busbar wall F120 penetration S120 MV Busduct with Copper or Aluminium conductor Floor penetration Alu + Cu = S120

 $^{^{\}star}$ The fire resistance class is highly dependent on thickness and quality of wall or floor.

 $^{^{\}star\star}$ L in 3 standard dimensions available 320mm, 420mm and 520mm.



Installation by Experienced Technicians

In order to better assist you in the successful realization of your projects, Eta-com puts its Installation & Service Department at your disposal.

The Installation & Service Department is in charge of the installation of betobar-r cast-resin insulated and other busduct systems, as well as related cast-resin products. To reach and guarantee the quality of our installation service, the installation team consists of skilled technicians with an educational background in industrial engineering or electricity.

Throughout their careers, our senior supervisors have gained extensive experience in site supervision for projects worldwide, often involving large-scale and complex installations such as offshore platforms, petrochemical power stations, refineries, oil tankers, nuclear power plants, hydropower plants, desalination plants, etc. Having built up this know-how over 20 years time, the technicians are capable of assessing and handling on- site betobar-r installation projects with efficiency.

Our Installation & Service Department and our engineers are SHE Checklist Contractors, VCA 2004/04 certified.

The Installation & Service Department and engineers can provide following services:

- Supervision to ensure safe and efficient reception of the busbars on-site:
- Installation of betobar cast-resin insulated and other busduct systems, as well as related cast-resin products
- Realization of casting junctions
- · Connection of the equipment
- Inspection and testing of the installation, including measuring the insulation and resistance values

Inspection and testing is carried out on completion of installation and maintenance activities, with results being documented. Should items not be acceptable against the agreed contract criteria, they will either be repaired, replaced or identified for a subsequent evaluation and decision. All repaired items are subject to a re-inspection to ensure acceptability.

On completion of installation and maintenance works, you as customer are also invited to check the work performed to ensure full acceptability.



Busway Route Planner

Customer: - Information req	uired for	anot	ation P	lease nho	tocony	this for	m ar	ıd atta	ch to	VOLI	inquir	v			Date	e: —		
In	Un	quot		req.	Ter	mp.		Proje		your	quii	y•						
А		V		Hz	t _o	°C t _{max}	С	Job r	nr:									
Conductors		3P	N	PE	+ -			Line			Lengtl	n	Out	door		ΔU	%	Tap off's
Cu□Al□								nr			total ı	m		m				In nr
	\times	\geq				\times			\rightarrow	\langle	\times	\nearrow	K			\geq		\star
	\times	>		$* \bigcirc$		\times		\mathbb{K}	>		\times		<	\geq		\geq		$\times\!$
	\times	\rightarrow		*		\times		\star	>		\times		<			\rightarrow		\times
	\times	\rightarrow		\star	$\langle \rangle$	\times		\times^*	\rightarrow	\langle	\times		\langle			\searrow		\star
\times		\leq	\times	\star	\nearrow	$\langle \cdot \rangle$	\times	\nearrow	\searrow	\nearrow	\searrow	\times				\leq	\nearrow	\star
$\times\!\!\!/\!\!\!\!/$		\leq	\times	$\downarrow \times$			\times		\subseteq	\geq		\times			\geq	\leq	\times	$\downarrow \times$
\times			\times		\rangle		\times			>		\times		<	\geq		$>\!$	
\times			\times		\searrow		\langle	\rightarrow	$\langle \uparrow$	>		\times				\langle	\times	\bigwedge
		\nearrow	\searrow	\mathbb{X}	\times			\times	\nearrow	\searrow	\nearrow	\downarrow	\searrow			\nearrow	\searrow	
	\times	\geq	$\langle \rangle$	$\times\!\!\!\!\!/$	\times	\times		\times	\rightarrow		\times		K			\geq		\mathbb{A}
	\times	>		\mathbb{X}	\times	\times		\times	>		\times		<			>		X
	\times	\rightarrow		$\star \bigcirc$	$\langle \rangle$	\times		\star	>	\bigcirc	>		\langle		<	\rightarrow		\times
		\searrow	$\langle X \rangle$	\star	\downarrow		\times	\downarrow	\searrow	\nearrow	\downarrow	\times			\geq	\searrow	\nearrow	\star
$\times\!\!\!\!/\!\!\!\!/$		\leq	\times	\downarrow \times	\downarrow		\times	\rightarrow		>		\times		\leq	\geq	\subseteq	\times	\downarrow \times
\times			\times		\rightarrow		\langle			>		\times		<	\geq		\gg	
\times		<	\times					\rangle	$\langle \uparrow \rangle$	\rightarrow		\times	\rangle			<	\times	
		\nearrow		\mathbb{X}	*			\times	\nearrow	\searrow	\nearrow	\downarrow	\searrow	\geq		\nearrow	\searrow	\times
	\times	\geq	$\langle \rangle$	$\times\!\!\!\!\!/$	\times	\times		\mathbb{K}	\rightarrow		\times		K			\geq		\times
	\times	\rightarrow		\mathbb{X}		\times		\times	>		\times		<			\rightarrow		X
	\times	\searrow		\star	\mathbf{X}^{\star}			\star	\rightarrow	$\langle \rangle$	\times		\langle			\searrow		$\mathbb{X}^{\mathbb{N}}$
\times		\leq	\nearrow	$\downarrow \times$	\nearrow		\times	\nearrow	\searrow	\nearrow	\searrow	\times				\leq	X	\mathbf{X}
$\times \downarrow \times$		\leq	\times	$\downarrow \times$	$\downarrow \rangle$		\times	$\downarrow \rangle$		>		\times		\leq	\geq	$\langle \rangle$	\times	\bigvee
\times			\gg		 		\langle			>		\times			>	$\langle $	\gg	
\times		$\langle \rangle$	\times		\downarrow			*	$\langle \uparrow \rangle$	\downarrow	$\langle \uparrow \rangle$	\times				$<\uparrow$	\times	
$\langle \rangle \langle \rangle \langle \rangle$	\times			\mathbb{X}	\mathbb{K}	\times		\times	\nearrow	\setminus	\times	$\downarrow \rangle$	\leq			\nearrow		\mathbb{A}
	\times	\rightarrow		\mathbb{X}	$\langle \rangle$	\times		\times	>		\times		<			>		$\times \triangleright$
				$\downarrow \nearrow$		\bigvee	\uparrow	$\downarrow \nearrow$	\bigvee		\bigvee							$\downarrow \uparrow$





FACTORY TEST REPORT L.V.

Project

DO(ODO)	1	Project no. Client Ext. ref			
A. PRODUCT IDENTIFICAT	ION				
Element no. Line no. TAG NR. Type Element form		U N U	lominal voltage Un Iser voltage Us Iominal current In Iser current Is Irequency	1.000 V (at 40 °C) (at 40 °C) 50 Hz	
B. VISUAL INSPECTION					
General aspect -	alue AL7032	Criteria client require	ments in PO, Eta-com	specs	Checked প্র প্র
C. DIMENSIONAL CHECK					
Property Va General aspect - Busduct L1 dimension Busduct L2 dimension Busduct L3 dimension Busduct L4 dimension	alue Un - mn mn mn	client require n n n	ments in PO, Eta-com	specs	Checked ☑ ☑ □ □
D. ELECTRICAL TESTS					
The electrical properties are che	cked conform	IEC 61439-1 & 6, th	ne PO and the client ap	oproved drav	vings
Property T	est value	Criteria			Checked
Power frequency test 5	kV AC, 1min	No breakdow	n, no flash over		Ø
Insulation resistance test 1 Phase sequence test -	kV DC	>= 5 Gohm Client approv	red drawings/order she	eet	Ą Ą
E. CONCLUSION					
Packing Material a	pproved as rea	vith the requirements ady for packing ady for shipment	3		Yes ♥ No □ Yes ♥ No □ Yes ♥ No □
Test engineer	Company		Test date		This document has been generated automatically from data of our quality
	ETA-COM	В	26/09/13		system and does not require a signature.
Witness	Company		Date		Signature

 _		
	_	 _
נת-		-

Doc.no.: FF-QC-031V4

TEST REPORT No:





FACTORY TEST REPORT M.V.

Project no. Client

		ient tt. ref			
A. PRODUCT IDENTIFIC	ATION				
Element no. Line no.		Nominal voltage User voltage Us	Ur 17500 V		
TAG NR.		Nominal current	Ir (at 40 °C)		
Туре		User current Is	(at 40 °C)		
Element form		Frequency			
B. VISUAL INSPECTION					
Property General aspect Element colour	Value -	Criteria client requirements in PO, Eta	a-com specs	Checked ☑ ☑	
Surface finishing flags					
C. DIMENSIONAL CHEC	CK .				
Property	Value Unit	Criteria		Checked	
General aspect		client requirements in PO, Eta	a-com specs	$ \checkmark $	
Busduct L1 dimension	464 mm			\checkmark	
Busduct L2 dimension	N/A mm				
Busduct L4 dimension	N/A mm				
Busduct L4 dimension	N/A mm				
D. ELECTRICAL TESTS					
The electrical properties are	checked conform in	ernational standards, the PO and	the client approved drawings		
Property	Test value	Criteria		Checked	
Power frequency test	Conform IEC6227 and IEC60060	No breakdown, no flash over	\checkmark		
Partial discharge test Phase sequence test	Conform IEC6027	P.D. level maximum 20pC at Client approved drawings/ord			
		Gioin approved diamingo.oid			
E. CONCLUSION					
	ement complies with			Yes ☑ No □	
•	al approved as read al approved as read	, ,		Yes ☑ No □ Yes ☑ No □	
Test engineer	Company	Test date	This docume	nt has been generated	
	ETA-COM B	26/09/13	automatically system and d	from data of our quality oes not require a	
Witness	Company	Date	signature. Signature		
	Simpany	Date			

		100
LCI	-CC	JIII

Doc.no.: FF-QC-030V4

TEST REPORT No:



Country	City	Project Name	Industry	LV/MV	Year		
Algeria	In Salah	Insalah Gas	Oil & Gas	LV	2008		
Algeria	Sidi Ben Adda	Terga	Power Plant	LV	2009		
Aruba	Oranjestad	Aruba Medical Centre	Hospital	LV	2010		
Australia	Onslow	Wheatstone Project LNG Plant	Oil & Gas	MV & LV	2013/14		
Australia	Onslow	Gorgon Onplots Project	Oil & Gas	MV & LV	2011/13		
Austria	Ös	Telekom Vienna	Telecommunication	LV	2003		
Austria	Vienna	Kaiser Franz Jozef Spital	Hospital	LV	2009		
Azerbaijan	Caspian Sea	CA-CWP Platform Azeri	Oil & Gas	LV	2003		
Bangladesh	Mymensing	Mymensing Power Plant	Power Plant	MV	2005		
Belgium	Leuven	UZ Leuven - Cabine 403	Hospital	LV	2008		
Belgium	Antwerp	ITC Rubis Terminal	Petrochemical	LV	2009		
Belgium	Antwerp	Total Petrochemicals	Petrochemical	MV	2008		
Belgium	Mechelen	KBC Data Centre	Data Centre	LV	2008		
Belgium	Lommel	Hansen Transmissions	Manufacturing	MV	2008		
Belgium	Antwerp	BASF	Chemicals	MV	2009		
Belgium	Antwerp	AHPHT - ESSO	Oil & Gas	LV	2009		
Belgium	La Hulpe	SWIFT	Banking	LV	2009		
Belgium	Leuven	UZ Leuven	Hospital	MV & LV	2009		
Belgium	Zwijndrecht	Borealis	Chemicals	LV	2010		
Belgium	Feluy	AFTON Chemicals	Chemicals	LV	2010		
Belgium	Feluy	TOTAL	Petrochemical	MV	2010		
Belgium	Mechelen	DuPont	Chemicals	LV	2010		
Belgium	Mechelen	Dow Belgium	Chemicals	LV	2010		
Belgium	Mechelen	P&G Mechelen	Manufacturing	LV	2011		
Belgium	Tessenderlo	Chevron Philips	Chemicals	LV	2012		
Brasil	Offshore	Petrobras P-50 offshore	Oil & Gas	MV	2003		
Colombia	Cartagena	Ecopetrol Cartagena Refinery	Petrochemical	LV	2010		
Colombia	Gartagoria	Petrominerales	Oil & Gas	LV	2010		
Colombia	Montelibano	Cerromatoso	Mining	MV	2011		
Colombia	Ayacucho	Ecopetrol Ayacucho Colombia	Petrochemical	MV	2011		
Congo	Offshore	Libondo Platform Congo	Oil & Gas	LV	2009		
Egypt	Damietta	LNG Train 2	Oil & Gas	MV & LV	2009		
	Cairo	Nile Tower 2	Real Estate	LV	2004		
Egypt Egypt	Alexandria	Sidi Kerir Petrochemicals	Petrochemical	LV	2007		
				LV			
France	Feyzin	TOTAL PO CAR MT	Petrochemical		2009		
France	Feyzin	TOTAL P2 - GAB MT	Petrochemical	MV	2009		
France	Duve and - i	Traversées Etanches - Projet BPC3	Manufacturing	LV	2009		
France	Drusenheim	DOW France Drusenheim	Chemicals	LV	2009		
France	Pierrelatte	Usine Rec II Pierrelatte	Nuclear Power Plant	LV	2010		
France	Lyon	Hôpital Neuro-Cardio Lyon	Hospital	LV	2010		
France	Donges	Total Donges	Petrochemical	MV	2011		
Germany	Frankfurt	Papermill WEPA	Paper Mill	LV	2003		
Germany	Boxberg	Kraftwerk Boxberg	Power Plant	LV	2008		
Germany	Frankfurt	Ticona Tiger	Chemicals	LV	2009		
Germany	Datteln	Eon Kraftwerk Datteln	Power Plant	LV	2011		
Germany	Köln	RWE Kraftwerk Fortuna	Power Plant	LV	2012		
Germany	Mannheim	Grosskraftwerk Mannheim	Power Plant	LV	2012		
Germany	Gaggenau/Rastatt	Daimler Trucks	Manufacturing	LV	2012		



Country	City	Project Name	Industry	LV/MV	Year
Germany	Wendefurth	Vattenfall Pumpstation Wendefurth	Substation	MV	2012
Germany	Offshore	Amrumbank	Wind Farm	LV	2013
Greece	Thinon	Wind Hellas Thinon	Telecommunication	LV	2008
Greece	Metamorfosi	Wind Hellas Metamorfosi	Telecommunication	LV	2008
India	Offshore	Offshore Platform	Oil & Gas	MV	2005
India	Greater Noida	JP Sport City Greater Noida	Utility	LV	2011
India	Bangalore	Oracle Bangalore	IT	LV	2011
Iraq	Majnoon	Shell Majnoon	Petrochemical	LV	2011
Ireland	Coolkeeragh	Power Station Coolkeeragh	Power Plant	LV	2003
Ireland	Belfast	BBC Belfast	Media	LV	2003
Ireland	Dublin	IBM SOR 37 IRELAND	Data Centre	LV	2008
Malaysia	Offshore	FPSO-MSE offshore	Oil & Gas	LV	2003
Malaysia	Bukit Rajah	Mox Bukit Rajah	Oil & Gas	MV	2010
Malaysia	Kerteh	Petronas	Oil & Gas	LV	2010
Malaysia	Peninsular Tapis Field	Exxon Mobil Tapis-R CCP Platform	Oil & Gas	LV	2011
Malaysia	Teluk Rubiah	Vale Miop	Mining	MV	2012
Malaysia	Sipitang	Samur Project	Chemicals	MV & LV	2013
Myanmar	Offshore	Yetagun platform	Oil & Gas	LV	2009
Myanmar	Offshore	Zawtika	Oil & Gas	LV	2012
Nigeria	Offshore	Bonny Island Refinery	Oil & Gas	LV	2003
Nigeria		NIPP	Oil & Gas	LV	2010
Norway	Oslo	Stortinget	Utility	LV	2003
Norway	Offshore	Hammerfest LNG plant	Oil & Gas	LV	2003
Norway	Offshore	Ekofisk offshore	Oil & Gas	MV	2004
Norway	Odda	Norzink	Chemicals	MV	2004
Norway	Stavanger	Navion Stavanger	Transportation	MV	2006
Norway	Glomfjord	Sitech Glomfjord	Manufacturing	LV	2008
Norway	Offshore	Valhall Aker	Oil & Gas	LV	2010
Norway	Ulsteinvik	Kleven	Transportation	LV	2012
Norway	Bodø	Kulturkvartalet Bodø	Utility	LV	2012/13
Oman	Qalhat	LNG Oman	Oil & Gas	MV	2003
Qatar	Offshore	Qatar Gas II	Oil & Gas	MV	2007
Qatar	Ras Laffan	Qatar Gas Common Sulphur	Oil & Gas	LV	2007
Qatar	Ras Laffan	Shell Pearl C4 - C5 - C6	Oil & Gas	LV	2007
Qatar	Ras Laffan	Ras Laffan	Oil & Gas	MV & LV	2007
Qatar	Offshore	Al Shaheen Maersk Oil	Oil & Gas	LV	2007
Qatar Qatar	Ras Laffan	Ras Gas Train 6&7	Oil & Gas	LV	2007
		Ras Laffan CCWP-II			
Qatar	Ras Laffan		Oil & Gas	MV	2010
Romania	Campulung	Holcim Cement Campulung	Manufacturing	MV	2010
Russia	Offshore	Sakhalin II Offshore	Oil & Gas	LV	2004
Russia	Moscow	Moscow City	Power Plant	MV	2006
Russia	Moscow	Substation Beskudnikovo	Power Plant	LV	2009
Russia	Khanti-Mansi	Priobskaya	Oil & Gas	MV	2009
Russia	Kodinsk	Boguchanskaya Hydro	Power Plant	MV & LV	2009
Russia	Novosibirskaya	Novosibirskaya	Power Plant	MV	2009
Russia	Nizhny Novgorod	Novogorkovskaya	Power Plant	MV	2009
Russia	Egorlykskaya	Egorlykskaya	Power Plant	MV	2010
Saudi Arabia	Shoaiba	Shoaiba Power Plant Units 1,2,3, 4, 5	Power & Desalination Plant	MV	2000/02



Country	City	Project Name	Industry	LV/MV	Year		
Saudi Arabia	Shoaiba	Shoaiba Power Plant stage II phase 1 & 2	Power & Desalination Plant	MV	2004/05		
Saudi Arabia	Shoaiba	Shoaiba Power Plant stage III	Power & Desalination Plant	MV	2009		
Saudi Arabia	Rabigh	Rabigh Power Plant	Power Plant	MV	2012		
South Africa	Lephalale	Medupi	Power Plant	LV	2009		
South Africa	Mpumalanga	Kusile	Power Plant	MV & LV	2010		
Spain	Olivenza	Astexol-2 Solar Plant Badajoz	Power Plant	MV	2010		
Spain	Alcazar de San Juan	Solar Power Plant Alcazar de San Juan ASTE 1A/1B	Power Plant	MV	2010		
Sweden	Kaarstoe	IBM Kaarstoe	IT	LV	2004		
Sweden	Kista	IBM Kista	IT	LV	2005		
Switzerland	Gösgen	KKW Gösgen	Power Plant	LV	2009		
Syria	Aleppo	Nahas Tower	Real Estate	LV	2007		
Syria	Ebla	GTP Syria Project	Power Plant	LV	2010		
Taiwan	Hualien	Bi Hai	Power Plant	MV	2004		
Thailand	Offshore	Bongkot - Central Facilities	Oil & Gas	LV	2010		
Thailand	Mae Moh	Egat Mae Moh Power Plant	Power Plant	MV	2011		
The Netherlands	Hengelo	Akzo Salinco	Petrochemical	MV	2005		
The Netherlands	Amstelveen	ABN Amro Computer Centre	Data centre	LV	2006		
The Netherlands	Amsterdam	AMC Amsterdam	Hospital	LV	2006		
The Netherlands	Amsterdam	KPN Amsterdam	Telecom	LV	2007		
The Netherlands	Amsterdam	ING Treasury	Data centre	LV	2008		
The Netherlands	Sluiskil	Yara	Manufacturing	MV	2009		
The Netherlands	Rotterdam	Power Station Maasvlakte	Power Plant	MV & LV	2010		
The Netherlands	Zwolle	Enexis Substation Zwolle	Power Plant	MV	2010		
The Netherlands	Amsterdam	Schiphol Backbone & KWS 2	Airport	LV	2010		
The Netherlands	Almelo	Urenco Hal 7	Manufacturing	LV	2010		
The Netherlands	Maastricht	Academic Hospital Maastricht	Hospital	LV	2010		
The Netherlands	Rotterdam	ING Wilgenplas	Data centre	LV	2010		
The Netherlands	Amsterdam	Nuon Powerstation Hemweg	Power Plant	LV	2011		
The Netherlands	Amsterdam	Global Switch Phase 1 - 3	Data centre	LV	2011		
The Netherlands	Bergen op Zoom	Sabic MCC 501 en 502	Petrochemical	LV	2011		
The Netherlands	Apeldoorn	Taxoffice Walter Bos & Quintax	Data centre	MV & LV	2011		
The Netherlands	Arnhem	Duiventil	Data centre	LV	2012		
The Netherlands	Terneuzen	Dow Chemical	Petrochemical	LV	2011		
The Netherlands	IJmuiden	Motorvessel Carolien	Maritime	LV	2012		
The Netherlands	Groningen	Enexis Substation Groningen	Substation	MV	2013		
The Netherlands	Beilen	Domo Friesland Campina	Food Industry	LV	2013		
U.A.E	Sharjah	Millennium Hotel	Real Estate	LV	2002		
U.A.E	Sharjah	Bin Sabath Tower	Real Estate	LV	2005		
U.A.E	Abu Dhabi	DIFC Gate Village	Utility	LV	2005		
U.A.E	Abu Dhabi	Al Nasser Tower	Real Estate	LV	2006		
U.A.E	Dubai	Between the bridges	Real Estate	LV	2007		
U.A.E	Sharjah	Sharjah Gate Tower	Real Estate	LV	2007		
U.A.E	Abu Dhabi	Yas Island DCP8,9	Disctrict Cooling Plant	LV	2008		
U.A.E	Abu Dhabi	BOROUGE 2	Oil & Gas	LV	2008		
U.A.E		Gasco Ruwais	Oil & Gas	LV	2006		
U.A.E	Abu Dhabi						
	Ruwais	Green Diesel	Oil & Gas	LV	2009		
U.A.E	Habshan	Habshan - 5 Process Plant	Oil & Gas	MV & LV	2010		
U.A.E	Dalma Island	Dalma Island	Real Estate	LV	2011		



Country	City	Project Name	Industry	LV/MV	Year
U.A.E	Abu Dhabi	Shah Gas Project 4	Oil & Gas	LV	2011/12
U.A.E	Ruwais	Ruwais Refinery Expansion 3 - 3.3kV	Oil & Gas	MV	2011/12
U.A.E	Abu Dhabi	Borouge 3 PP/PE	Oil & Gas	LV	2011/12
U.A.E	Abu Al Abyadh	Shah Sulphur Station & Pipelines Project	Oil & Gas	LV	2012
U.A.E	Abu Dhabi	Satah Full Field Development Project	Oil & Gas	LV	2012/13
U.A.E	Habshan	NGI (Pure Case) Project	Oil & Gas	LV	2012/13
U.A.E	Abu Dhabi	LIWA Pumping Station	Water Treatment	LV	2012/13
United Kingdom	Warwick	IBM Warwick	Data Centre	LV	2006
United Kingdom	Cardiff	IDC Cardiff PH2	Data Centre	LV	2006
United Kingdom	Bletchley	BT Bletchley	Telecommunication	LV	2006
United Kingdom	Wynyard	Wynyard (EDS)	Commercial	LV	2008
United Kingdom	Walsall	Walsall Hospital	Hospital	LV	2009
United Kingdom	Cruachan	Cruachan II	Power Plant	MV	2009
United Kingdom	London	Nomura Bank Project Shinkyo	Commercial	LV	2009/10
United Kingdom	Isleworth	BSkyB Harlequin 1	Data Centre	LV	2010
United Kingdom	Fawley	Esso Fawley	Oil & Gas	LV	2010
United Kingdom	Sunderland	EDS DOXFORD	Data Centre	LV	2011/12
United Kingdom	London	Blackfriars Station	Rail	LV	2011/12
United Kingdom	London	79-97 Wigmore Street	Commercial	LV	2012
United Kingdom	Beckton	Beckton STW	Water Treatment	LV	2012
United Kingdom	Gartcosh	Scottish Crime Campus	Utility	LV	2012
United Kingdom	Fife	Markinch Biomass CHP Plant	Biomass	MV	2012
United Kingdom	Shetland Islands	Laggan Tormore	Oil & Gas	LV	2013
Yemen	Kharir	Kharir Project Phase 1 & 2	Oil & Gas	MV & LV	2009
Yemen	Kharir	Total E&P Yemen Kharir Power Plant	Oil & Gas	MV & LV	2011/12

Notes	3													



Ísobar



Isolated Phase Busducts (11~36kV up to 30000A)



Segregated / Non-Segregated Phase Busducts (415~33kV up to 6500A)





Low Voltage



Medium Voltage

metabar



Sandwich Busbar Trunking System (Low-Impedance) (400~6600A)



Air Insulated Busbar Trunking System (125~2000A)



Lighting Trunking System (25~63A)





GLOBAL SPECIALISTFOR POWER BUSBARS

Corporate Office:

222, Okhla Industrial Estate, New Delhi-110 020, India

Tel.: +91-11-30884912, 30887520-29 Fax: +91-11-26848241, 26847342 email: info@etacomcs.com

Works:

Belgium Plant Scheldeweg 4,

2850, Boom, Belgium

Tel.: +32-3-880.64.00 Fax.: +32-3-844.4 2.50 email: busduct@etacom.be

India Plant:

Plot No. 1C, Sector 8C, Integrated Industrial Estate (SIDCUL), Ranipur, Haridwar Uttarakhand - 249403, India

Sales Office:

Belgium Office:

Scheldeweg 4, 2850, Boom, Belgium

Tel.: +32-3-880.64.00 Fax.: +32-3-844 .4 2.50 email: busduct@etacom.be

Netherland Office:

Zwarte Zee 2-6, 3144, DE MAASSLUIS, The Netherlands Tel.: +31-1059-16422

Tel.: +31-1059-16422 Fax: +31-1059-20673 email: info@etacom.nl

UK Office:

Unit 19/20, Horsham Court, City Business Centre, 6, Brighton Road, HORSHAM, West Sussex, RH13 5BB,

United Kingdom
Tel.: +44-1-403265767
Fax: +44-1-403254131
email: busduct@eta-com.co.uk

www.cselectric.co.in www.etacomcs.com



